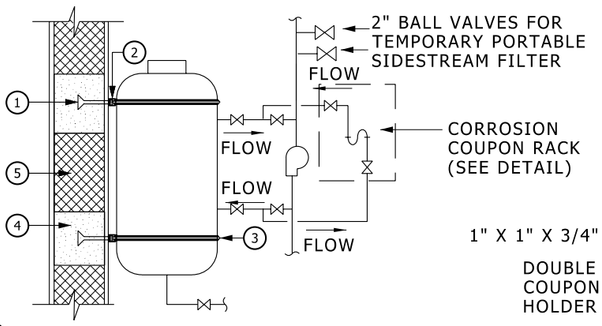

1. ½" HILTI, KWIK BOLT II S.S. MIN. 4 ½" EMBEDMENT FOR EACH BRACKET TYP. OF 2)
2. UNISTRUT P1000 16" LONG (TYP.)
3. CUSH-A-CLAMP UNISTRUT UB10PA (TYP.)
4. PROVIDE CAST IN PLACE CONCRETE (TYP.)
5. EXISTING BLOCK WALL

NOTE: PIPING SIMILAR TO FLOOR MOUNTED

WALL MOUNTED TANK

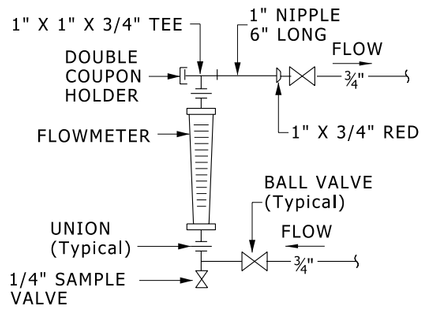

CORROSION COUPON RACK

CORROSION COUPON RACK:

CHILLED WATER SYSTEMS SHALL INCLUDE PVC PIPE, BALL VALVES AND COUPON HOLDERS. HOT WATER SYSTEMS SHALL INCLUDE STAINLESS STEEL PIPE & COUPON HOLDERS AND BRONZE BALL VALVES. DOUBLE COUPON HOLDER SHALL BE FROM ALABAMA SPECIALTY PRODUCTS WITH COPPER AND MILD STEEL COUPONS.

FLOW METER:

0-7 GPM PISTON/SPRING FLOW INDICATOR IN CLEAR POLYSULFONE CYCLINDER WITH 3/4" BRASS CONNECTIONS RATED FOR 250F - HEDLAND EZ-VIEW MODEL H625-007.

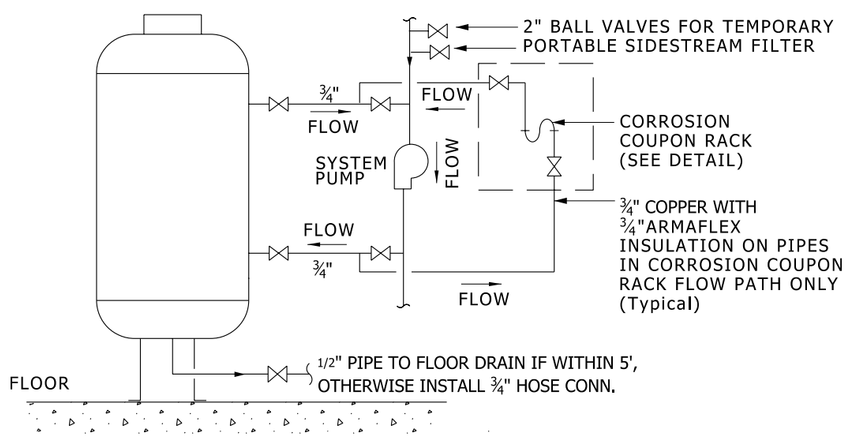

SHOT FEEDER:

CHEMICAL POT FEEDER SHALL BE 5 GALLON MINIMUM AND SHALL CONSIST OF A TANK BODY, THREADED, GASKETED REMOVABLE TOP, MINIMUM SIZE 4" FOR INTRODUCTION OF CHEMICAL (DRY OR LIQUID), AND DRAIN & VENT PETCOCKS. FUNNEL TYPE TOPS ARE NOT ACCEPTABLE.

THE FEEDER SHALL BE PIPED ACROSS THE CIRCULATING PUMP SO AS TO INSURE POSITIVE FLOW THROUGH THE TANK. IT SHOULD BE PIPED SO THAT FLOW IS IN THE BOTTOM AND OUT THE TOP.

THE FEEDER SHALL BE FIRMLY MOUNTED TO FLOOR AND NOT SUPPORTED BY THE SUPPLY AND RETURN PIPING. THE FEEDER TOP OPENING SHOULD NOT BE MORE THAN 48 INCHES ABOVE THE FLOOR TO AVOID ANY SPLASHING OF CHEMICALS ON THE OPERATOR.

CLOSED SYSTEM SHOT FEEDER DETAIL

NO SCALE

D 15189 01 04 08.dgn

REFERENCED DETAILS/SCHEDULES:
XXXX
XXXX
XXXX
XXXX
XXXX
XXXX
XXXX
XXXX
ADDITIONAL INFORMATION:
MODULES: X

UNIVERSITY OF MICHIGAN
ARCHITECTURE, ENGINEERING AND CONSTRUCTION
ARCHITECTURE & ENGINEERING
326 East Hoover, Mail Stop B
Ann Arbor, MI 48109-1002
Phone: 734-764-3414
Fax: 734-936-3334

Closed System
Shot Feeder Detail

DIVISION: 15
SECTION: 15189
FILE: D 15189 01 04 08.dgn
ISSUE DATE: 04/15/08