



1/2" COPPER SAFETY DRAIN WITH CONNECTION TO SITE WASTE (REQUIRED ONLY WHERE SPECIFICALLY NOTED ON DRAWING)



FOR CONTINUOUS AIR VENTING

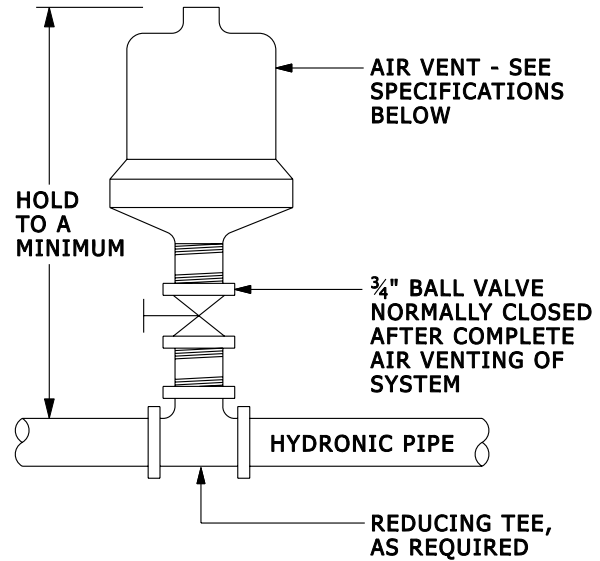

NOTES:

1. AUTOMATIC AIR VENTS ARE REQUIRED AT EACH HIGH POINT IN HYDRONIC PIPING TO COMPLETELY VENT AIR FROM WATER SYSTEMS.
2. FOR PIPE SIZES 2-1/2" AND LARGER, PROVIDE HOFFMAN MODEL 78 AIR VENT, OR ARMSTRONG NO.75, RATED FOR 150 PSI.
3. FOR PIPE SIZES 2" AND LESS, PROVIDE BELL & GOSSETT MODEL 87 AIR VENT, OR ARMSTRONG NO.75, RATED FOR 150 PSI.
4. ONLY WHEN AIR VENT INSTALLATION IS NOT POSSIBLE, PROVIDE A GOOSENECK PIPE FITTING AT BALL VALVE DISCHARGE FOR COLLECTION OF CARRY-OVER WATER.

AUTOMATIC WATER SYSTEM AIR VENT DETAIL

NO SCALE

D 15515 002 06 04.dgn

REFERENCED DETAILS/SCHEDULES:
xxxx S XXXXX XXX

ADDITIONAL INFORMATION:

MODULES: X

THE UNIVERSITY OF MICHIGAN
PLANT EXTENSION
ARCHITECTURE, ENGINEERING & CONSTRUCTION
ARCHITECTURAL AND
ENGINEERING SERVICES
326 EAST HOOVER STREET
ANN ARBOR, MI 48109-1002

**Automatic Water System
Air Vent Detail**

DIVISION: 15
SECTION: 15515
FILE: D 15515 002 06 04.dgn
ISSUE DATE: 06/01/04